




- General Notes**
- The drawing has been checked in accordance with the Electrical Engineering (Regulation) Act 2002.
  - Do not scale from this drawing. All dimensions indicated are in millimeters unless otherwise stated. Verify dimensions on site.
  - All cables and equipment dimensions are typical. The Contractor should check actual dimensions and equipment data.
  - This drawing is to be used in conjunction with all relevant BS and IEC specifications. It is intended as a guide only and does not constitute a contract. Responsibility for the accuracy of the information is the responsibility of the Contractor.
  - The drawing is not intended to be used for construction purposes. It is intended to be used for information purposes only.
  - Contractor to coordinate with relevant authorities for all services and equipment.
  - The Contractor shall be responsible for the correct installation and operation of all services and equipment.
  - The Contractor shall be responsible for the correct installation and operation of all services and equipment.
- Legend**
- DP Draw pit
  - Proposed MV 'A' trunk containing 12 No. 100mm<sup>2</sup> uPVC ducts
  - Proposed MV 'B' trunk containing 12 No. 100mm<sup>2</sup> uPVC ducts
  - Proposed Fiber 'A' Alternative route trunk containing 6 No. 200 (dia) mm uPVC duct (By Freedom)
  - Proposed FT 'A' trunk containing 2 x 50mm<sup>2</sup> uPVC ducts
  - Proposed FT 'B' trunk containing 2 x 50mm<sup>2</sup> uPVC ducts
  - Existing Essex and Suffolk Water Mains Cold Water Supply
  - Existing Essex and Suffolk Water Mains Cold Water Infrastructure
  - Proposed extension of Essex and Suffolk Water Mains Cold Water Supply
  - Proposed Fiber 'A' trunk containing 6 x 200mm<sup>2</sup> uPVC ducts
  - Proposed Fiber 'B' trunk containing 6 x 200mm<sup>2</sup> uPVC ducts
  - Proposed route of Freedom incoming 11kV power supply
  - Existing DNO (UKPN) local 11kV HV infrastructure
  - Proposed extension to DNO (UKPN) local 11kV HV infrastructure
  - Existing drainage pipe/manhole cover
- Note**
- No private services have been shown as they do not appear on public records which form the basis of this drawing.
  - Please read in conjunction with logic and phasing plan.

1 Callout - Yewtree Avenue Site Entrance  
NTS

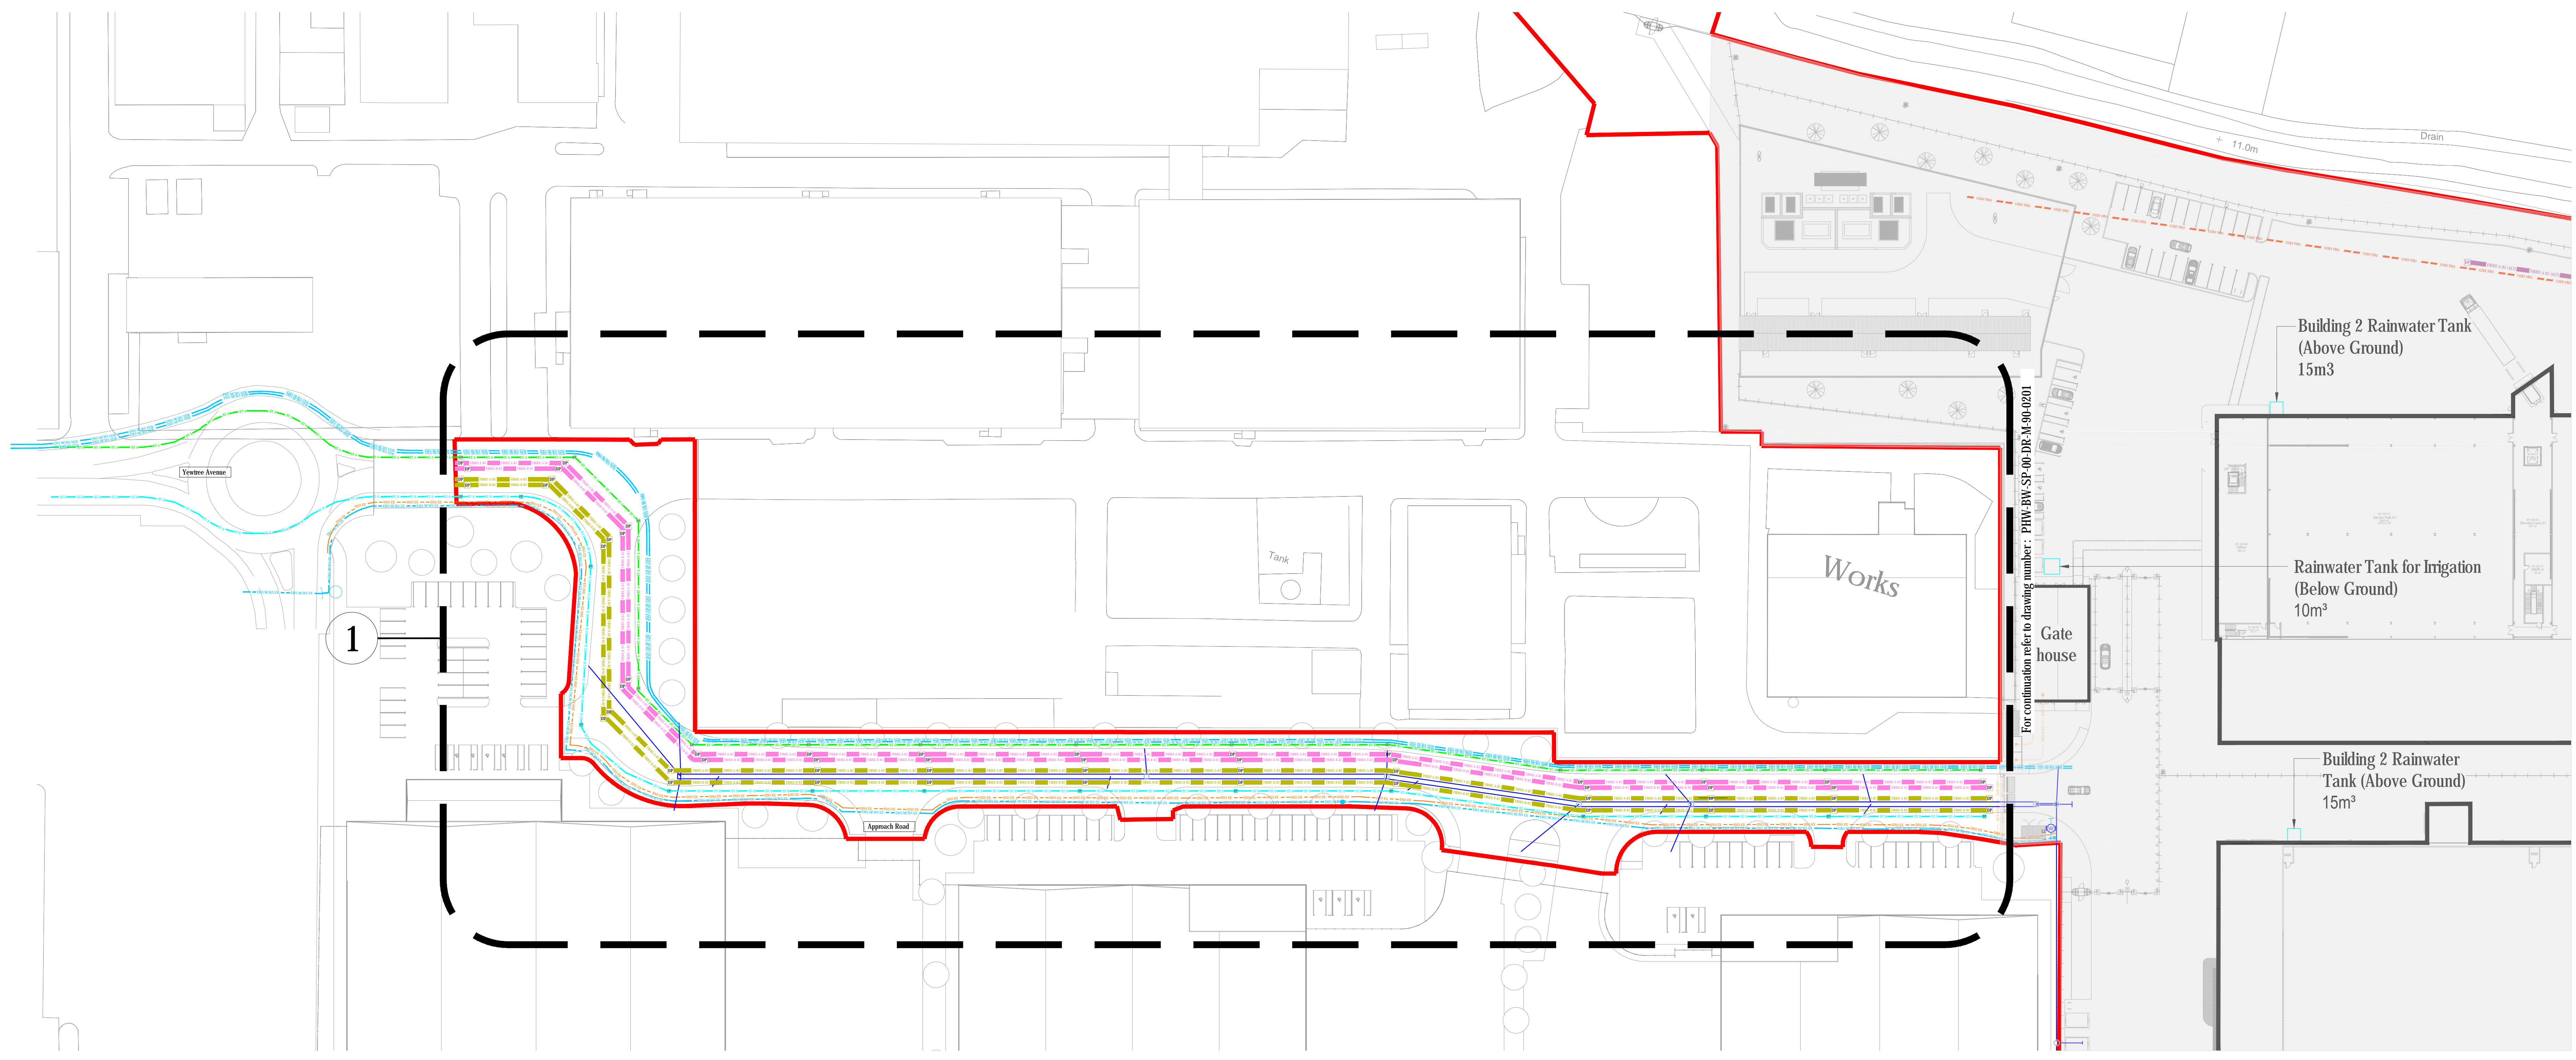

2	Issued for planning	REL / SET / SHS	01 / 06 / 19
3	Issued for planning	REL / SET / SHS	01 / 06 / 19
Rev	Drawn	By / CMM / App	Date

For continuation refer to drawing number: PHW-BW-SP-00-DR-M-90-0201

28 St Workshop Street  
London  
E2 8 3JH  
Tel: +44 (0) 20 485 7206  
www.the-engineering.com

**&**

CLIENT  
NTT Communications Corporation

PROJECT TITLE  
NTT Communications Data Centre  
Yewtree Avenue, Dagenham  
RM10 7XS

DRAWING TITLE  
Combined MEP Services  
Incoming Services  
Site Wide  
Sheet 2 of 2

JOB NO  
P20010

STATUS  
For Planning

SCALE AT A0  
1:500

DISCIPLINE  
Mechanical

DRAWING NUMBER  
PHW-BW-SP-00-DR-M-90-0202

SHEET  
2